


Tableau Réglages des Vannes TA par Colonne

BATIMENT - A -			BATIMENT - B -			BATIMENT - C -			BATIMENT - E -		
Colonne	Nbires de Tour	DN	Colonne	Nbires de Tour	DN	Colonne	Nbires de Tour	DN	Colonne	Nbires de Tour	DN
A1	4.5	20	B2	2.0	32	C1	3.0	32	E1		25
A2	4.0	25	B2 bis	3.0	15	C2	4.0	25	E2	4.0	20
A3	4.0	15	B3	3.0	32	C3	4.0	30	E3	4.0	25
A3 bis	4.0	15	B4	4.0	25	C4			E4	4.0	25
A4		32	B5	4.0	15	C5	4.0	32	E5	4.0	20
A4 bis	4.0	315	B5 bis	4.3	32	C6	4.0	25	E6		
A5	4	20	B6	4.0	15	C7	4.0	32	E7	4.0	32
A7	3.6	20	B7	3.0	40	C8	4.0	40	E8		
A9	4.0	32	B8	2.0	32	C9	4.0	20	E9	4.0	32
A10		30	B9	2.0	32	C10	4.0	25			
			B10	4.0	25	C10 bis	4.0	25			
			B11	1.5	15	C11	4.0	40			
			B12	4.0	32	C12	4.3	32			
			B13			C13	4.4	25			
			B13 bis	2.0	25	C14	4.0	32			
			B14	2.0	25	C15	4.0	20			
			B15	2.0	25	C16	4.4	25			
			B16	4.0	25	C17	3.0	32			
			B16 bis			C18	4.0	20			
			B17	3.0	32	C19					
			B17 bis	3.0	15	C20	4.0	40			
			B18	3.0	15	C21	4.0	25			
			B19			C22	4.0	32			
			B20	3.0	25	C23	4.0	32			
			B21	3.0	32	C24	4.0	20			
			B22	3.0	20	C25	4.0	25			
			B23	3.0	20	C26	4.0	32			
			B24	4.0	15	C27	4.0	15			
			B25			C28	4.0	20			
			B27	2.6	32	C29	4.3	32			
			B28			C30	4.3	32			
			B29	2.0	32	C30 bis	4.0	25			
			B30			C31	4.0	32			
			B31	3.0	32	C32	4.0	32			
			B32			C33	4.0	32			
			B33								
			B34	3.0	32						

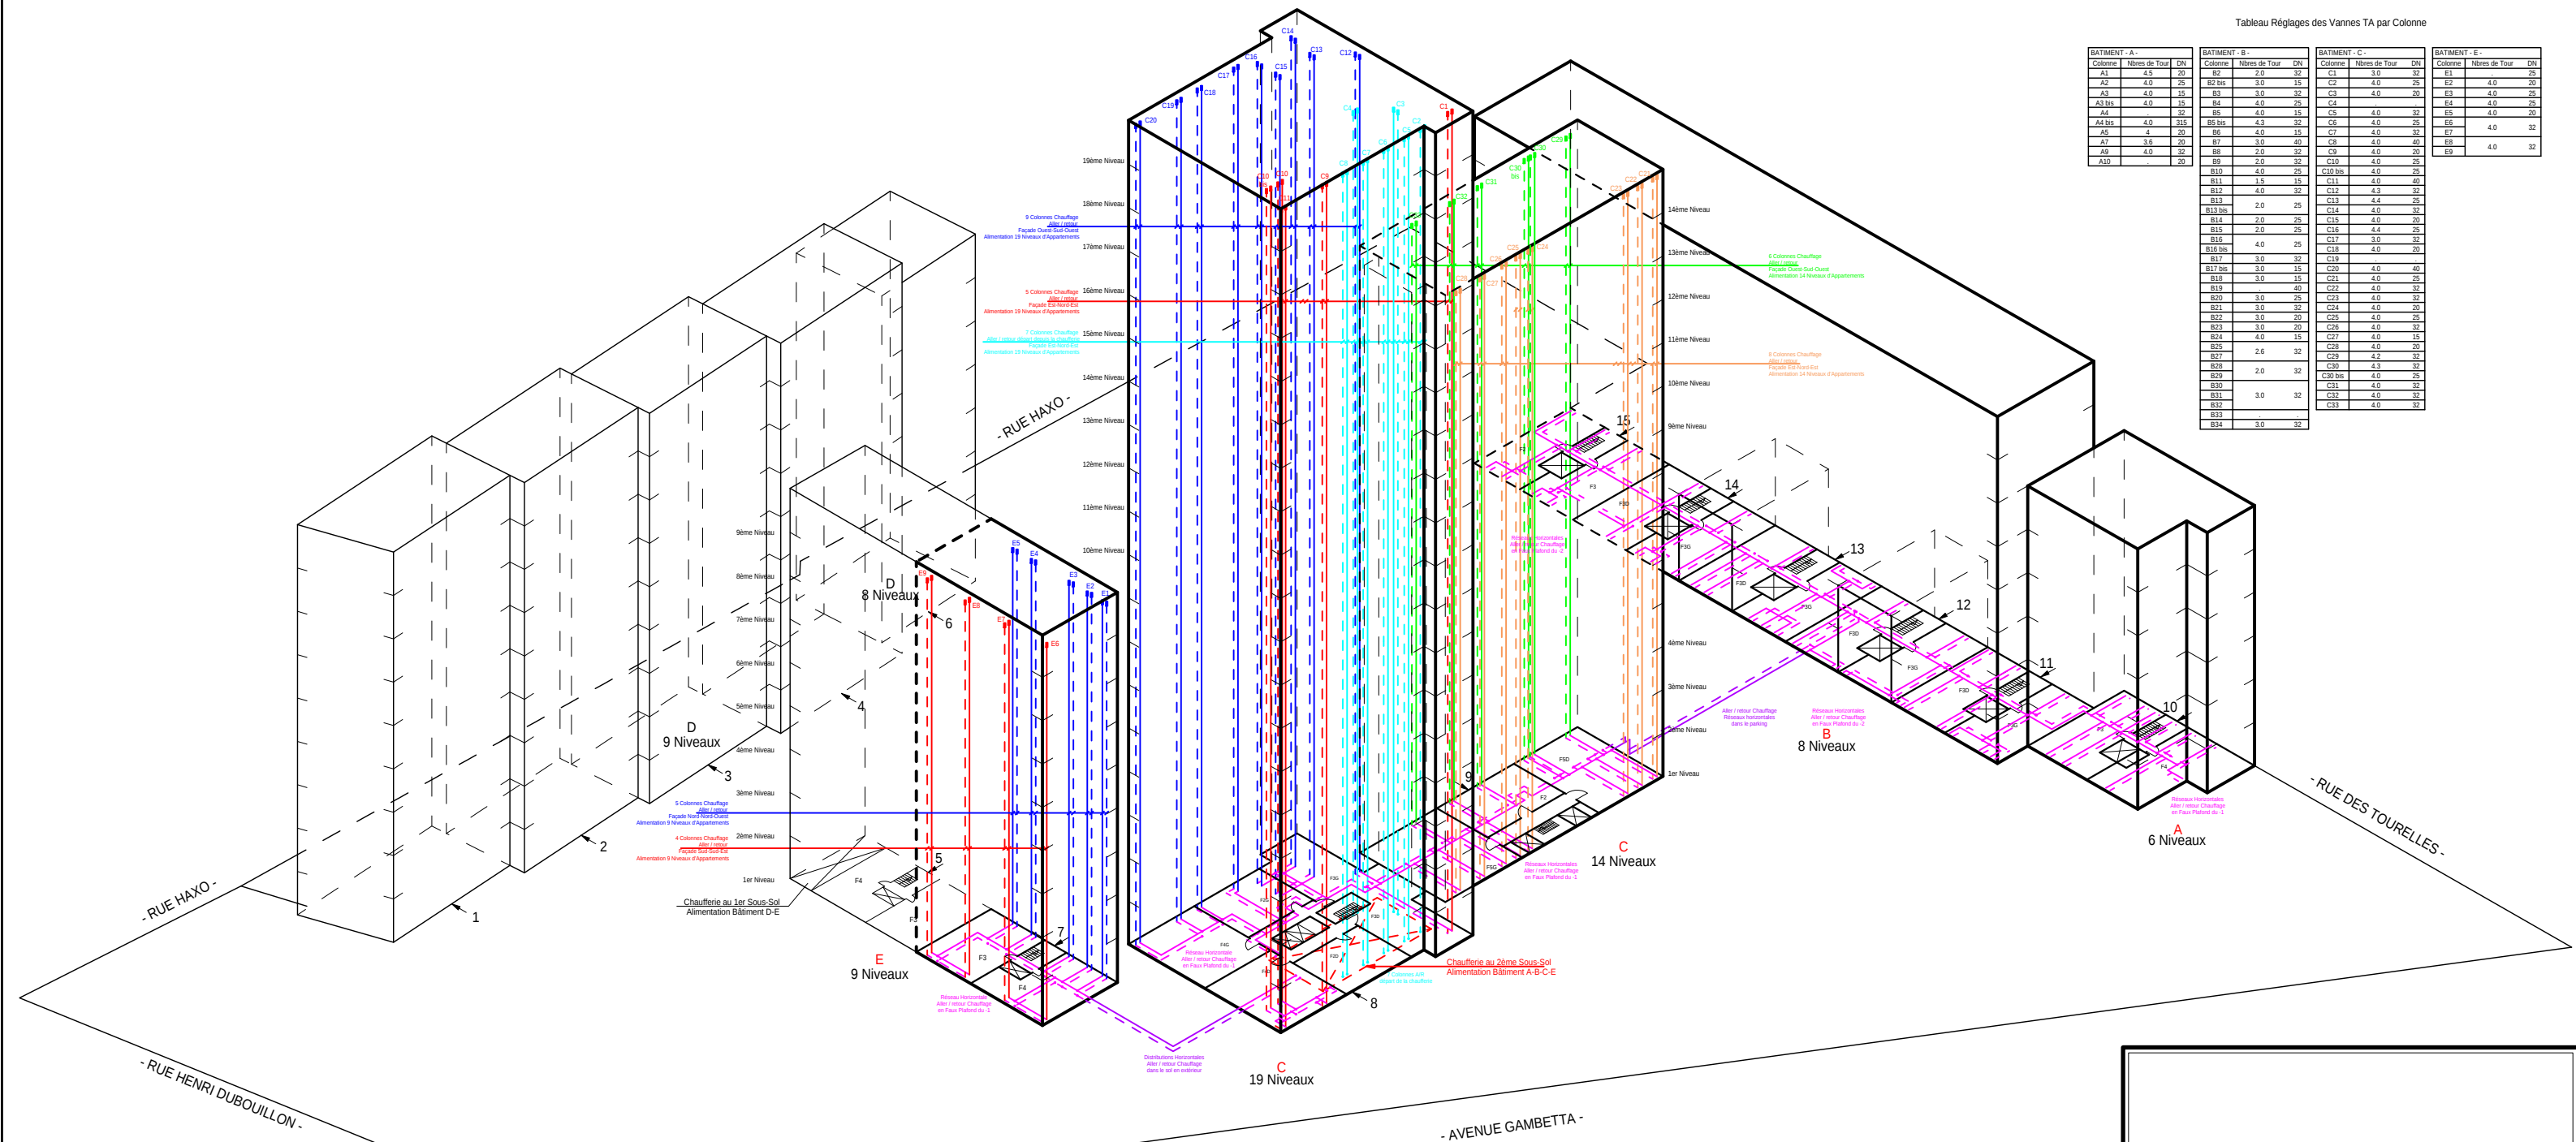

- Synoptique Colonnes Chauffage -
- Bâtiment C & E -

Entreprise :

Date :	Echelle :
Octobre 2007	Schématique
Numéro de Plan :	Indice :
03	.